



INTERSECTION VALVE LOCATIONS DETAIL W-5

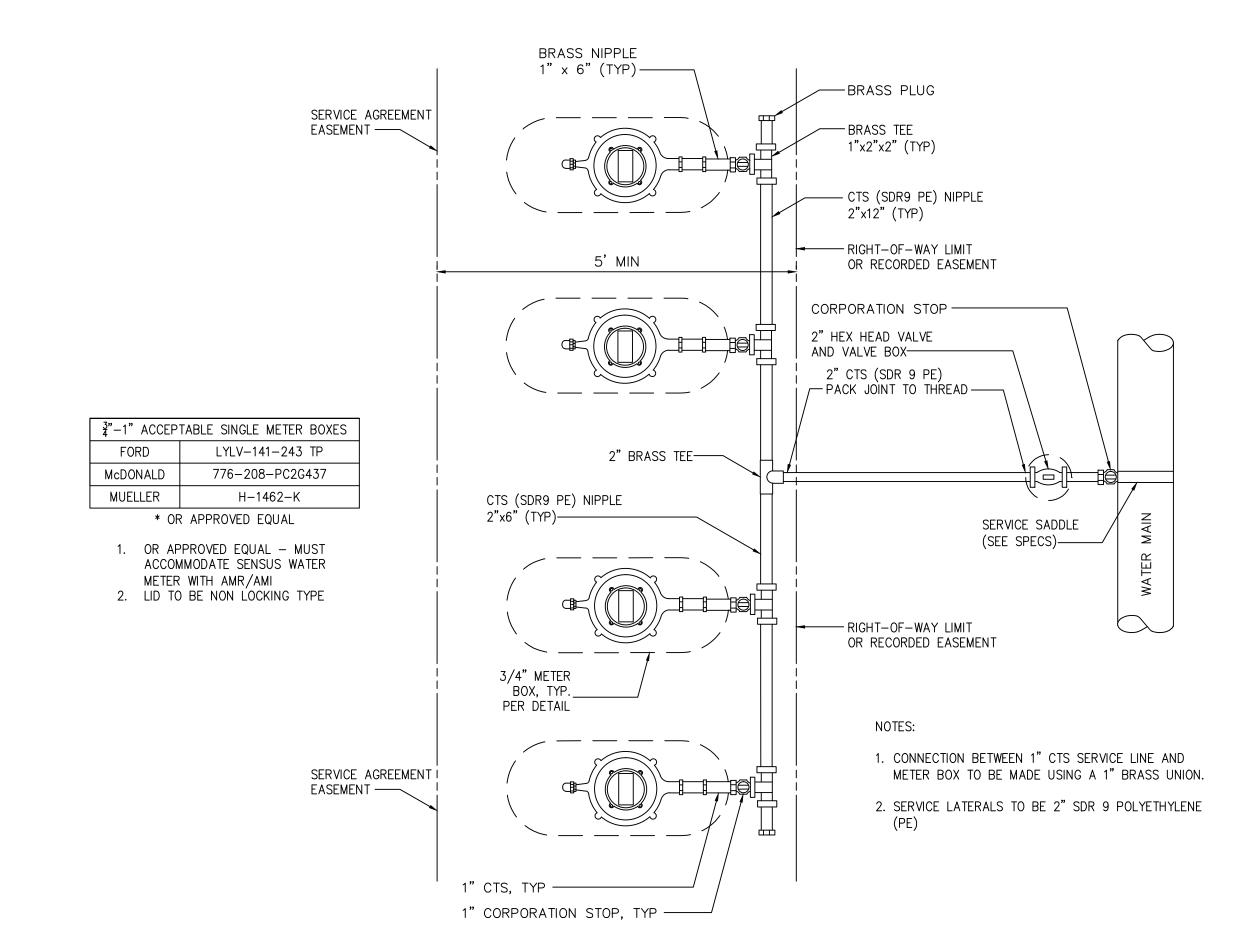

STANDARD GANG METER ASSEMBLY DETAIL W-6

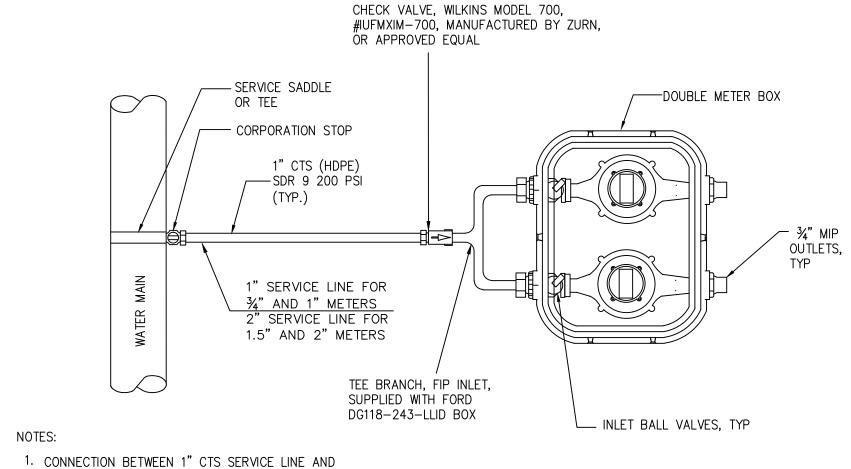


BACKFLOW PROTECTION DEVICE IS REQUIRED ON ALL IRRIGATION WATER METERS AND ON ALL COMMERCIAL/INDUSTRIAL WATER METERS

ACCEPTABLE DOUBLE METER BOXES FORD DG 118-243-LLID WITH LID # RT-10X13LID * OR APPROVED EQUAL

- OR APPROVED EQUAL MUST ACCOMMODATE TWO (2) SENSUS WATER METERS WITH AMR/AMI
- 2. LID TO BE NON LOCKING TYPE


PLAN VIEW FOR WATER/IRRIGATION SPLIT SERVICE (WATER/IRRIGATION SERVICÉS INSTALLED CONCURRENTLY)

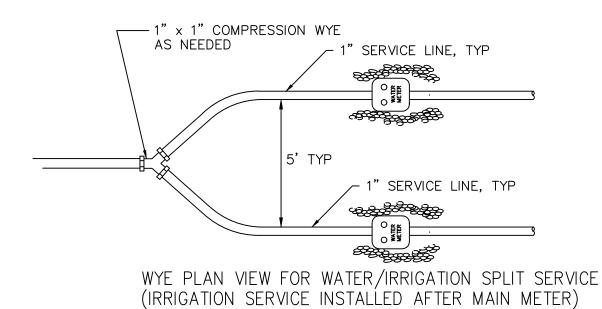

YOKE BOX TO BE MADE USING A 1" BRASS

3"-1" ACCEP	TABLE SINGLE METER BOXES
FORD	LYLV-141-243 TP
McDONALD	776-208-PC2G437
MUELLER	H-1462-K
* OR APPROVED EQUAL	

- OR APPROVED EQUAL MUST ACCOMMODATE SENSUS WATER
- METER WITH AMR/AMI

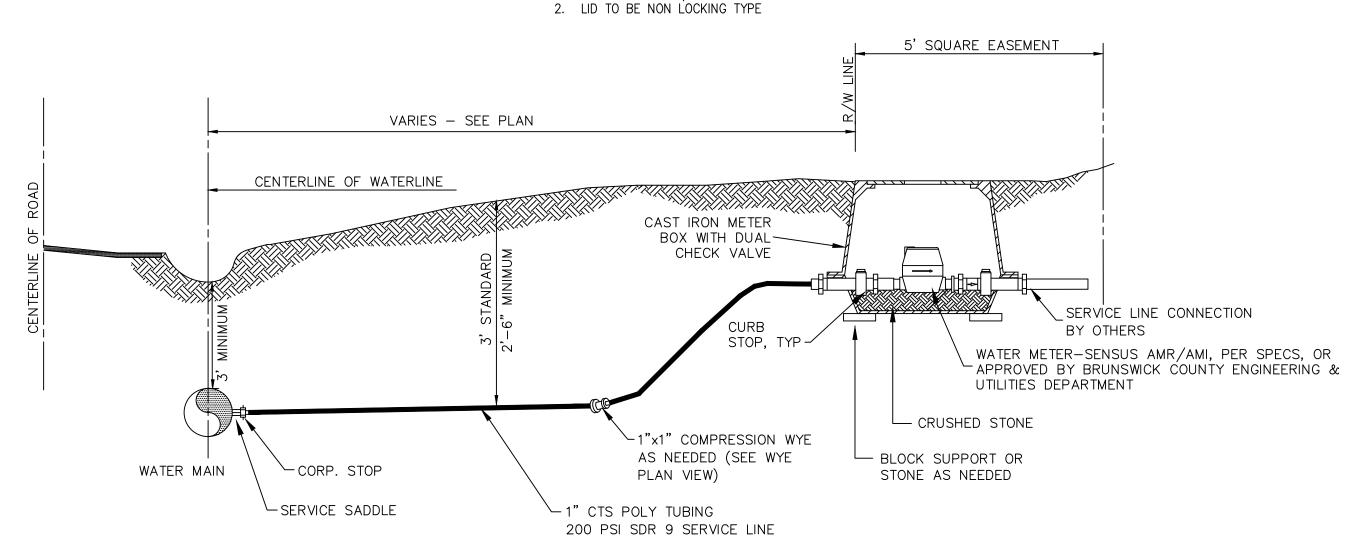

- 1) CONTRACTOR SHALL PLACE METER BOX IN NON-TRAFFIC AREA AT LOCATION SPECIFIED BY BRUNSWICK COUNTY ENGINEERING DEPARTMENT.
- 2) METERS SHALL BE SET BY BRUNSWICK COUNTY.
- 3) METER BOXES SHALL BE CAST IRON WITH DUAL CHECK VALVES. 4) 1 1/2" AND 2" METERS WILL REQUIRE 2" CTS POLY TUBING.
- 5) 1 1/2" AND 2" METERS WILL REQUIRE A METER BOX SIZED ADEQUATELY

TO HOUSE A 1 1/2" OR 2" SENSUS METER.

<u>3/4" - 2" STANDARD WATER TAP</u> INSTALLATION DETAIL W-7

(FOR METERS LARGER THAN 2", REFER TO DETAIL ON PAGE 3 OF 5)

Drawn By: JDM Checked By: WLP

Date: <u>05-23-12</u>

Scale: NTS

2 OF 5

Revisions

1.1 - DATED 3/7/2013 Modified double meter box 1.2 - DATED 4/5/2013

Corrected meter box #'s